EWAD700BJYNN/Z + OPTP
EWAD750BJYNN/Q + OPTP



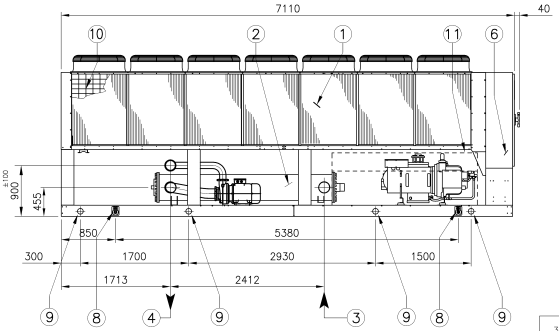

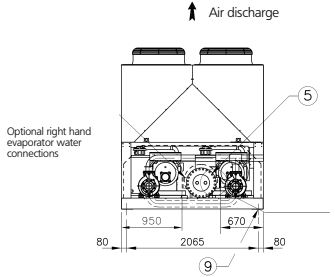



Fan arrangements and minimum clearance requirements

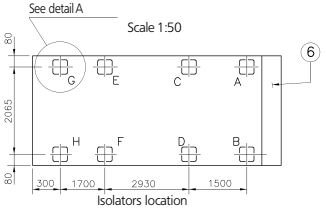

Isolators location

Legend

① Condenser coil
② Evaporator
③ Pump (evaporator) water inlet
④ Evaporator water outlet
⑤ Victaulic connections for 168.3 O.D. tube
⑥ Operating and control panel
⑦ 330x180 slot for power and control panel connection
⑧ 4 Raising plate
⑨ 8 isolator mounting holes 25 mm DIA.
⑩ Coil protection guards (optional)
⑪ Compressors enclosure (only XN version)

Version	Condenser type	Weight KG		Isolators load KG							
		Shipping	Operating	A	B	C	D	E	F	G	H
EWAD700BJYNN/Z+OTP EWAD750BJYNN/Q+OPTP	Aluminium Acylic coated	6820	7070	1150	1245	1060	1135	890	845	360	385
EWAD700BJYNN/Z+OPTP EWAD750BJYNN/Q+OPTP	Rubber isolators	Type (q/ty)		786010-m (4 Pz.)				786010-h (2 Pz.)		786010-m (2 Pz.)	

Detail B



Detail "A" rubber isolator