
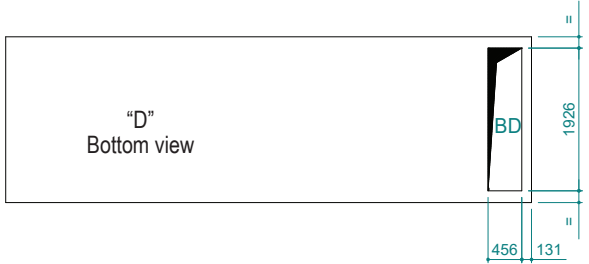
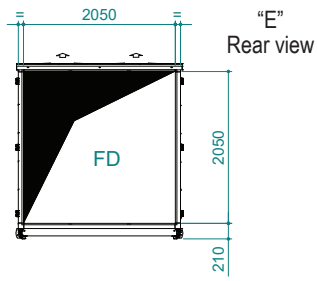
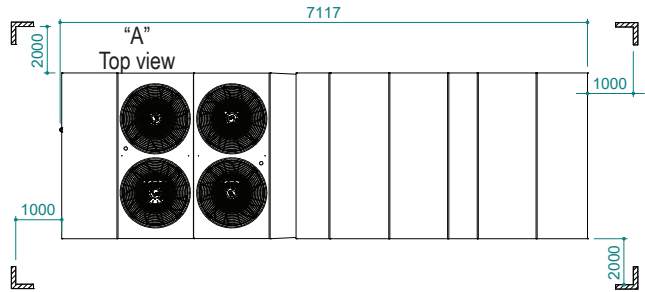
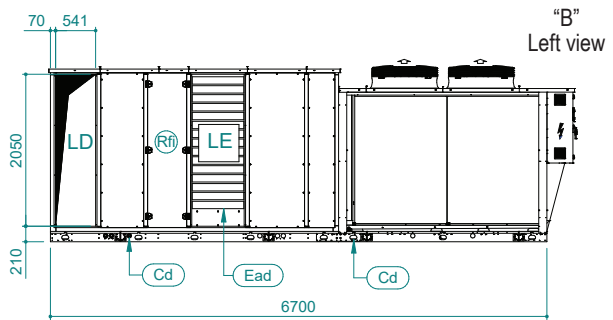
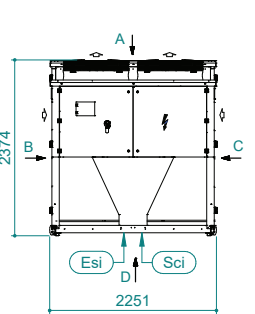


# UATYA140-190BFC3Y1

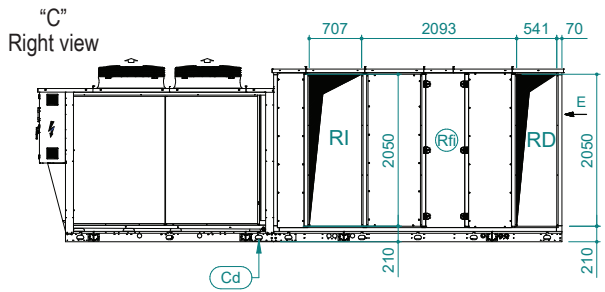

Air direction			
Air direction	Discharge	Intake	External
Left	LD	/	LE
Right	RD	RI	/
Bottom	BD	/	/
Front	FD	/	/

Sci	Signal cables inlet
Cd	Condensate drain 1" male

Ead	External air damper
Rfi	Remove for inspection

Esi	Electrical supply inlet
	Clearances