


FXFA-A

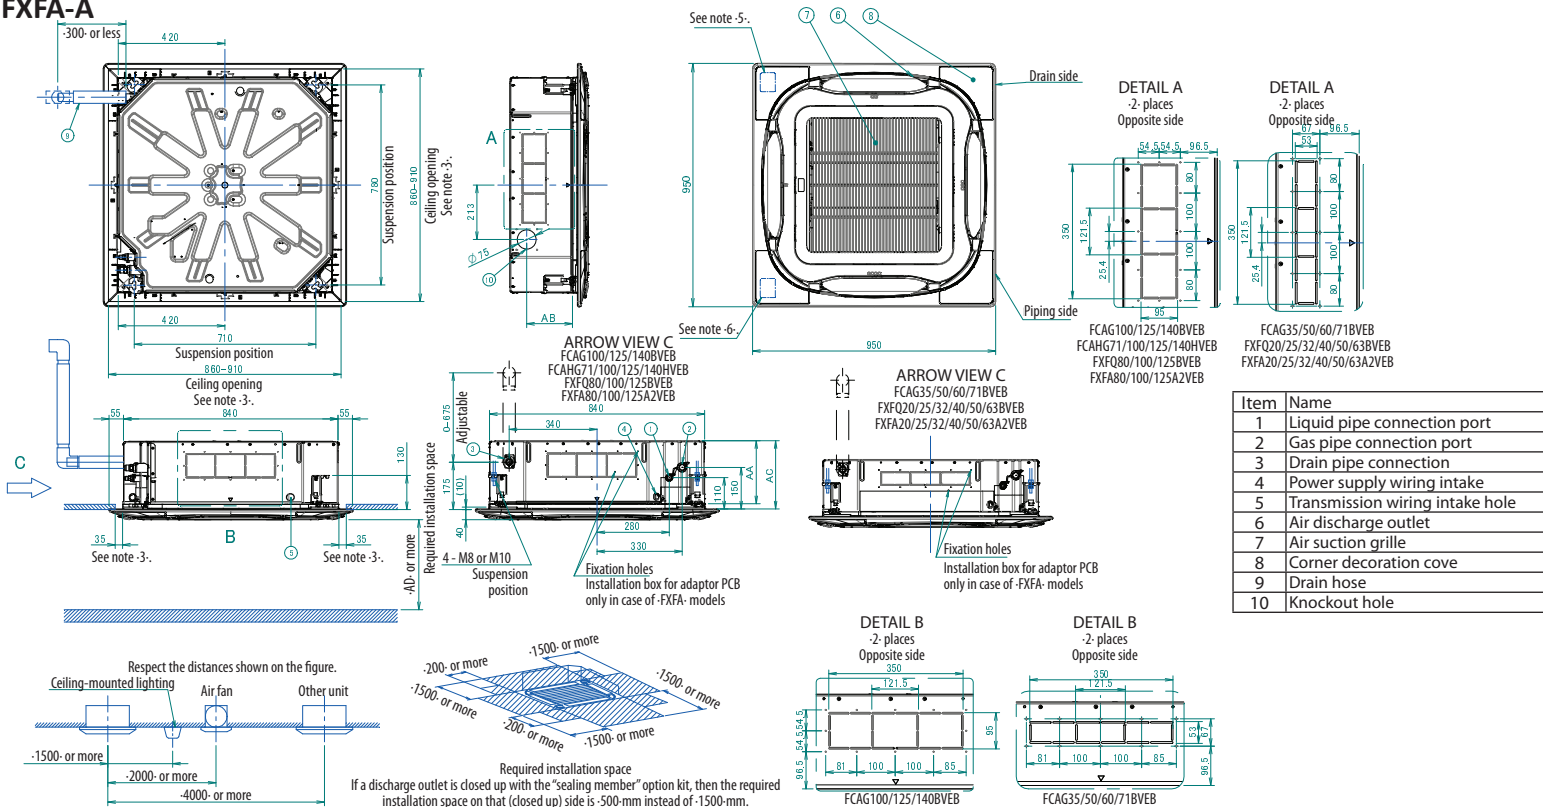

Cassette height	Minimal installation height	Required installation space		Model
204	139	227	2700	FCAG35/50/60/71BVEB
246	180	269	2700	FCAG100/125/140BVEB
288	180	311	2700	FCAHG71/100/125/140HVEB
204	139	227	2700	FXFQ20/25/32/40/50/63BVEB
246	180	269	2700	FXFQ80/100BVEB
288	180	311	2700	FXFQ125BVEB
204	139	227	2500	FXFA20/25/32/40/50/63A2VEB
246	180	269	2500	FXFA80/100A2VEB
288	180	311	2500	FXFA125A2VEB

NOTES

- Location of nameplate:
The unit nameplate is located on the control box cover.
The decoration panel nameplate is located on the piping-side panel frame, under the corner cover.
- When installing optional accessories, refer to their respective documentation.
- Make sure the distance between the ceiling and the cassette does not exceed 35-mm. The maximum ceiling opening is 910-mm.
- When the conditions in the ceiling exceed 30°C ambient temperature and 80% relative humidity, or when fresh air is inducted into the ceiling, additional insulation is required (polyethylene foam, thickness ≥ 10-mm).
- When installing a sensor kit, there will be a sensor on this location. For details, see the drawing of the sensor kit.
- When installing a wireless controller, there will be a receiver on this location. For details, see the drawing of the wireless controller.