





**WARNING**

- Do not use means to accelerate the defrosting process or to clean the equipment, other than those recommended by the manufacturer.
- The appliance shall be stored in a room without ignition sources in continuous operation (for example: open flames, an operating gas appliance or an operating electric heater).
- Do not pierce or burn.
- Be aware that the R32 refrigerant does not contain an odour.

**INSTALLATION SPACE REQUIREMENTS**

- Installation of pipework shall be kept to a minimum.
- Pipework shall be protected from physical damage and shall not be installed in an unventilated space, if the space is smaller than the minimum size as defined in the table below.
- For installation inside a building (this applies to indoor units and to outdoor units installed inside) a minimum floor area of the room may be required. This is specified in the graph on the right and the table below. The table contains rounded figures. For a more precise determination, the values can be determined from the graph on the right side.
- For outdoor units installed inside (winter garden, garage, machinery room etc.) take the determination for floor standing units.
- To determine the minimum floor area, the total refrigerant charge needs to be taken into account (total value ③, which is the sum of pre-charge ① and additional field charge ②).
- The minimum floor area [m<sup>2</sup>] is determined based on the installation height of 1.8m for wall-mounted units and 2.2m for ceiling-mounted units.

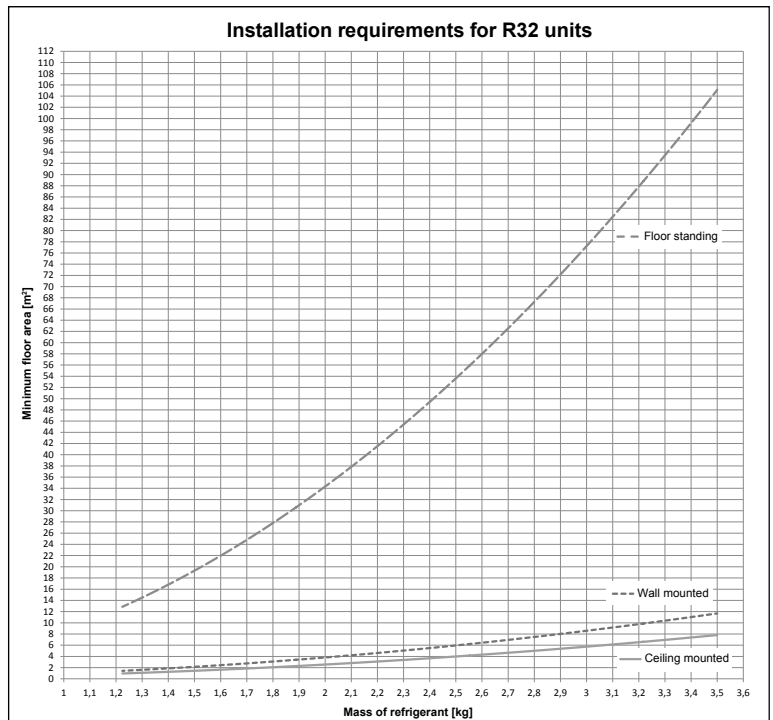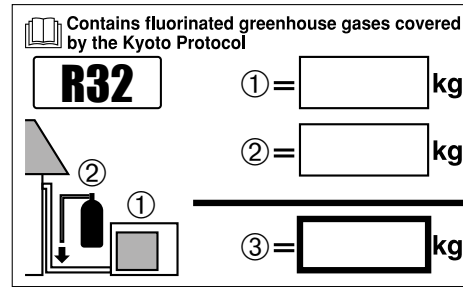

Minimum floor area for equipment installed inside (applies to indoor units and outdoor units installed inside)					
Ceiling-mounted units		Wall-mounted units		Floor-standing units	
m(kg)	A <sub>min</sub> (m <sup>2</sup> )	m(kg)	A <sub>min</sub> (m <sup>2</sup> )	m(kg)	A <sub>min</sub> (m <sup>2</sup> )
1.224	Without restriction	1.224	Without restriction	1.224	Without restriction
1.225	0.96	1.225	1.43	1.225	12.88
1.3	1.08	1.3	1.61	1.3	14.50
1.4	1.25	1.4	1.87	1.4	16.82
1.5	1.44	1.5	2.15	1.5	19.31
1.6	1.63	1.6	2.44	1.6	21.97
1.7	1.84	1.7	2.76	1.7	24.80
1.8	2.07	1.8	3.09	1.8	27.80
1.9	2.30	1.9	3.44	1.9	30.98
2.0	2.55	2.0	3.81	2.0	34.32
2.1	2.81	2.1	4.20	2.1	37.84
2.2	3.09	2.2	4.61	2.2	41.53
2.3	3.38	2.3	5.04	2.3	45.39
2.4	3.68	2.4	5.49	2.4	49.42
2.5	3.99	2.5	5.96	2.5	53.63
2.6	4.31	2.6	6.44	2.6	58.00
2.7	4.65	2.7	6.95	2.7	62.55
2.8	5.00	2.8	7.47	2.8	67.27
2.9	5.37	2.9	8.02	2.9	72.16
3.0	5.74	3.0	8.58	3.0	77.22
3.1	6.13	3.1	9.16	3.1	82.46
3.2	6.54	3.2	9.76	3.2	87.86
3.3	6.95	3.3	10.38	3.3	93.44
3.4	7.38	3.4	11.02	3.4	99.19
3.5	7.82	3.5	11.68	3.5	105.11